
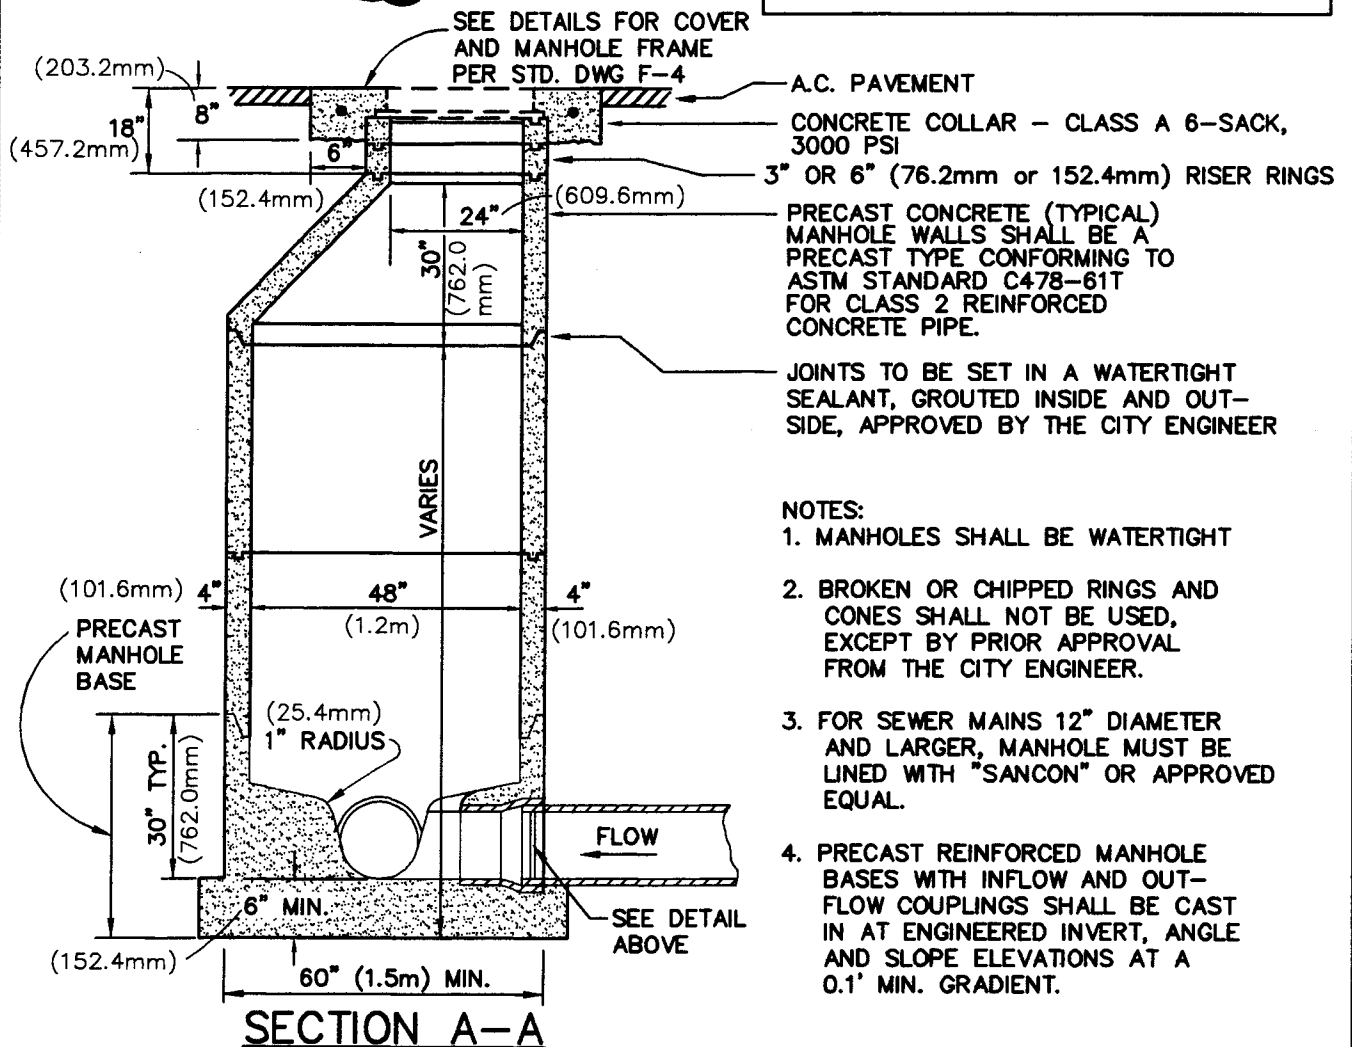
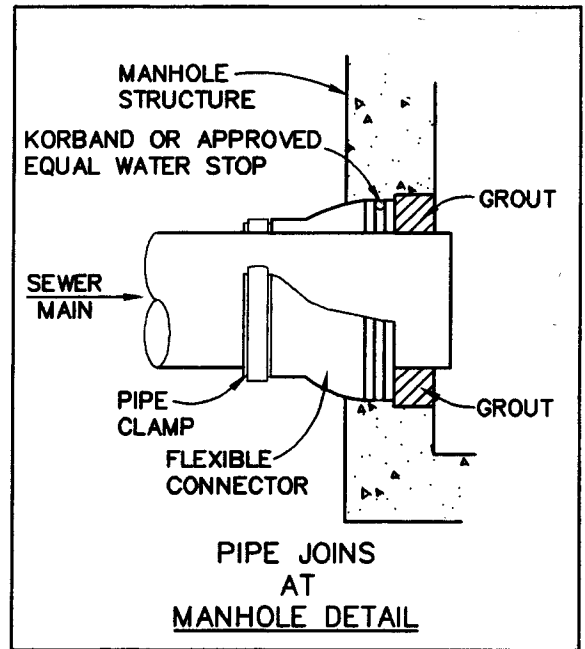


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

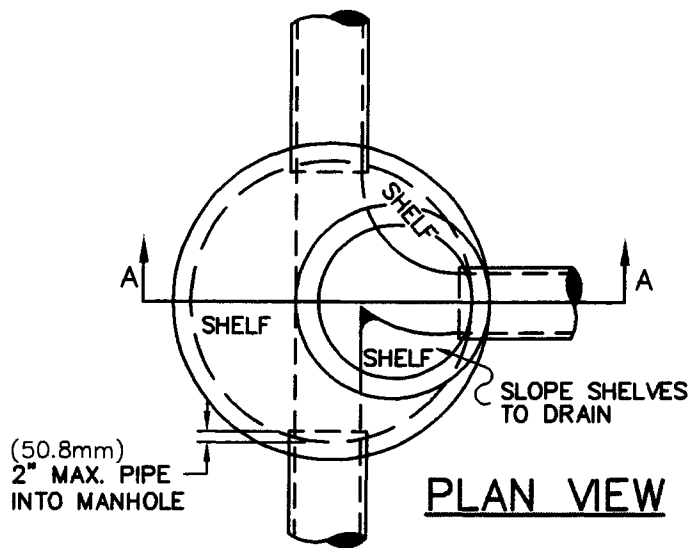

NOTES:

1. MANHOLES SHALL BE WATERTIGHT
2. BROKEN OR CHIPPED RINGS AND CONES SHALL NOT BE USED, EXCEPT BY PRIOR APPROVAL FROM THE CITY ENGINEER.
3. FOR SEWER MAINS 12" DIAMETER AND LARGER, MANHOLE MUST BE LINED WITH "SANCON" OR APPROVED EQUAL.
4. PRECAST REINFORCED MANHOLE BASES WITH INFLOW AND OUT-FLOW COUPLINGS SHALL BE CAST IN AT ENGINEERED INVERT, ANGLE AND SLOPE ELEVATIONS AT A 0.1' MIN. GRADIENT.

DRAWN BY:
C.A.C.
DESIGNED BY:

CITY OF PASO ROBLES
ENGINEERING DIVISION

DRAWING NO.

DATE:
4/18/94
FILE NAME:
PR-F-1.DWG

**STANDARD SEWER MANHOLE
WITH PRECAST BASE**

F-1